



Famtun Silo

Water Tank Base Requirements

It is recommended to site onto a concrete base. The concrete should be a minimum of 100mm thickness. The concrete should be type C20 300kg/m³ For more information please call the Sales Office.


Tank Diameter (metres)	Tank Diameter (feet)	Minimum base diameter (metres)	Concrete Required (m ³)	Sand Required (m ³)
2.74	9	3.34	0.88	0.30
3.65	12	4.25	1.42	0.53
4.57	15	5.17	2.10	0.82
5.48	18	6.08	2.91	1.18
6.40	21	7.00	3.85	1.61
7.32	24	7.91	4.92	2.10
8.23	27	8.83	6.12	2.66
9.14	30	9.74	7.46	3.28
10.06	33	10.66	8.92	3.97
10.97	36	11.57	10.52	4.73
11.89	39	12.49	12.25	5.55
12.80	42	13.40	14.11	6.44
13.71	45	14.31	16.10	7.39
14.63	48	15.23	18.22	8.41
21.03	69	21.63	36.75	17.37

Address: No.69,Huaihe Road, Dongying city, Shandong Province,China.
Tel: 86-546-6087589
Email: joe.duan8621@famtunsilo.com
Website: <http://famtunsilosystem.com>



Water Tank Base Requirements

It is recommended to site onto a concrete base. The concrete should be a minimum of 100mm thickness. The concrete should be type C20 300kg/m³ For more information please call the Sales Office.

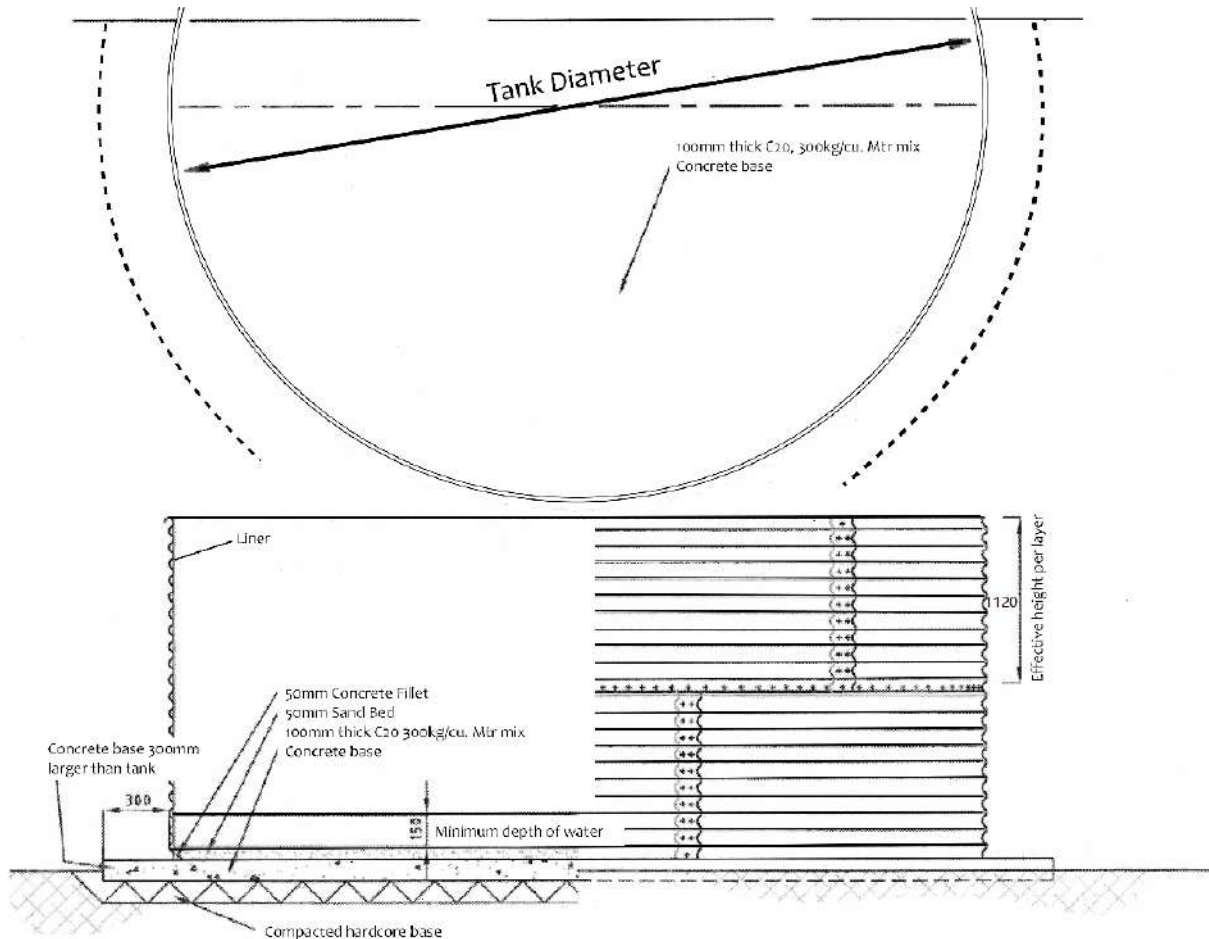

Address: No.69,Huaihe Road, Dongying city, Shandong Provience,China.
Tel: 86-546-6087589
Email: joe.duan8621@famtunsilo.com
Website: <http://famtunsilosystem.com>



Water Tank Base Requirements

It is recommended to site onto a concrete base. The concrete should be a minimum of 100mm thickness. The concrete should be type C20 300kg/m³ For more information please call the Sales Office.



Address: No.69,Huaihe Road, Dongying city, Shandong Provience,China.
Tel: 86-546-6087589
Email: joe.duan8621@famtunsilo.com
Website: <http://famtunsilosystem.com>